

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO H.S.

Date 3/28/88

Building H

Inspector JES

Location H-1 STORAGE R.M.
(functional area)

HMS-CHS-31

Material: Surfacing (TSI) Misc. % Asbestos 75-80
Description PIPE WRAP

Amount of Material (NF / F) 56/0 (ft²/lf) Assumed ACM: Y / N # of samples _____

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility:	H	<u>M</u>	L
Vibration :	H	M	<u>L</u>
Soil Erosion :	H	M	<u>L</u>
Water :	H	M	<u>L</u>


PREVENTATIVE MEASURES:

1. Fix Leaks
2. Prevent water contact
- 3 Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS
 isolate/restrict repair/cleanup
 enclose encapsulate
 remove O&M

ACBM Condition - Assessment

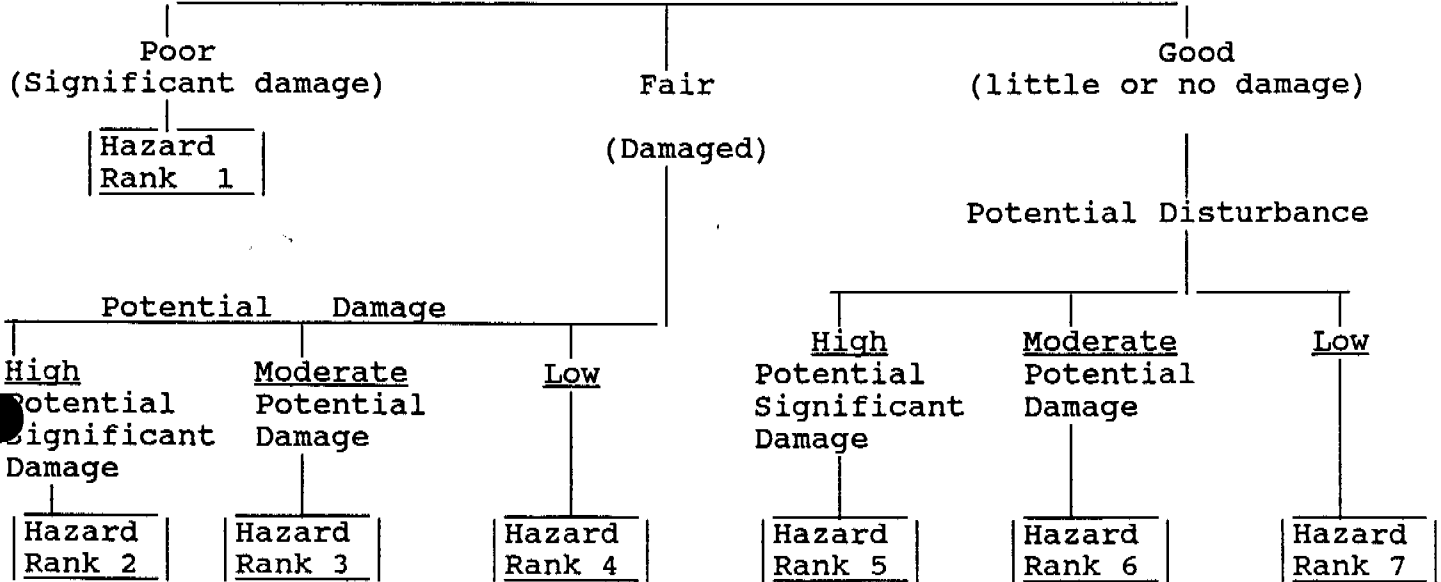

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO HS.

Date 3/28/98

Building H

Inspector JES

Location H-1 STORAGE RM
(functional area)

HMS-CHS-32

Material: Surfacing (TSP) Misc. % Asbestos 75-80
Description MUDDY JOINTS

Amount of Material (NF / F) SAME AS #31 (ft²/lf) Assumed ACM: Y / N # of samples

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

PREVENTATIVE MEASURES:


Accessibility: H (M) L
 Vibration : H M (L)
 Air Erosion : H M (L)
 Water : H M (L)

1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS
 isolate/restrict repair/cleanup
 enclose encapsulate
 remove (O&M)

ACBM Condition - Assessment

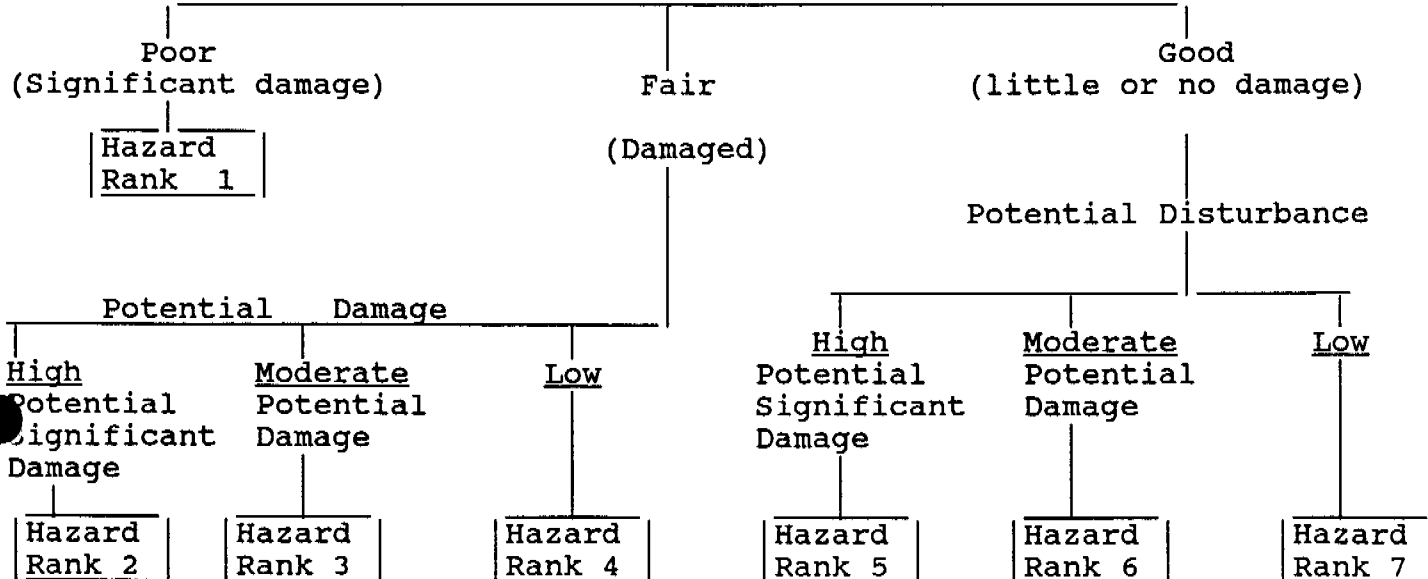

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO H.S.

Date 3/28/88

Building INDUSTRIAL ARTS

Inspector JES

Location AUTO SHOP
(functional area)

HMS-OHS - 45

Material: Surfacing (TSI) Misc. % Asbestos 35-40
Description PIPE WRAP STRAIGHT

Amount of Material (NF / F) 180 / 0 (ft² / lf) Assumed ACM: Y / N # of samples 350

CONDITION: % damaged: Extent of damage:
 0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility: H M
 Vibration : H M
 Air Erosion : H M
 Water : H M

PREVENTATIVE MEASURES:


1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS

isolate/restrict repair/cleanup
 enclose encapsulate
 remove O&M

ACBM Condition - Assessment

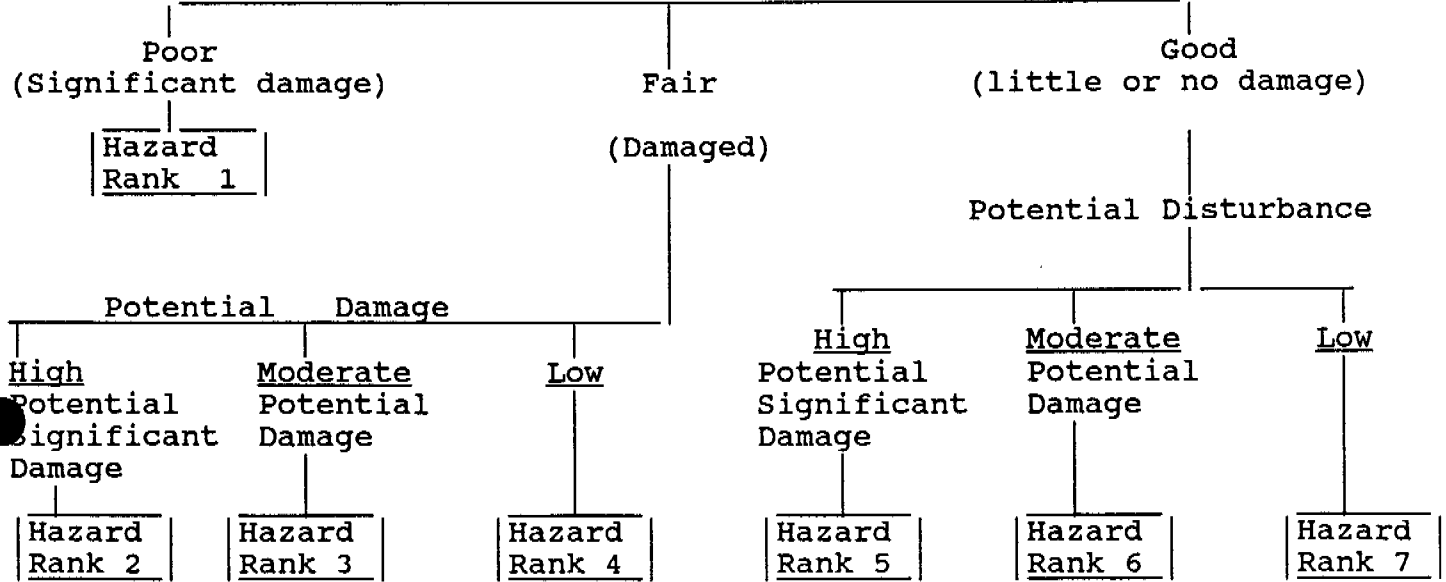

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO H.S.

Date 3/28/88

Building AG

Inspector JES

Location SHOP Welding BOOTHS
(functional area)

HMS-CHS-48

Material: Surfacing (TSI) Misc. % Asbestos 15-20
Description TRANSITE WELDING BOOTH

Amount of Material (NF / F) 150 (ft²/lf) Assumed ACM: Y / N # of samples 7

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility: H M L
Vibration : H M L
Air Erosion : H M L
Water : H M L

PREVENTATIVE MEASURES:


1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS

isolate/restrict repair/cleanup
enclose encapsulate
remove O&M

ACBM Condition - Assessment

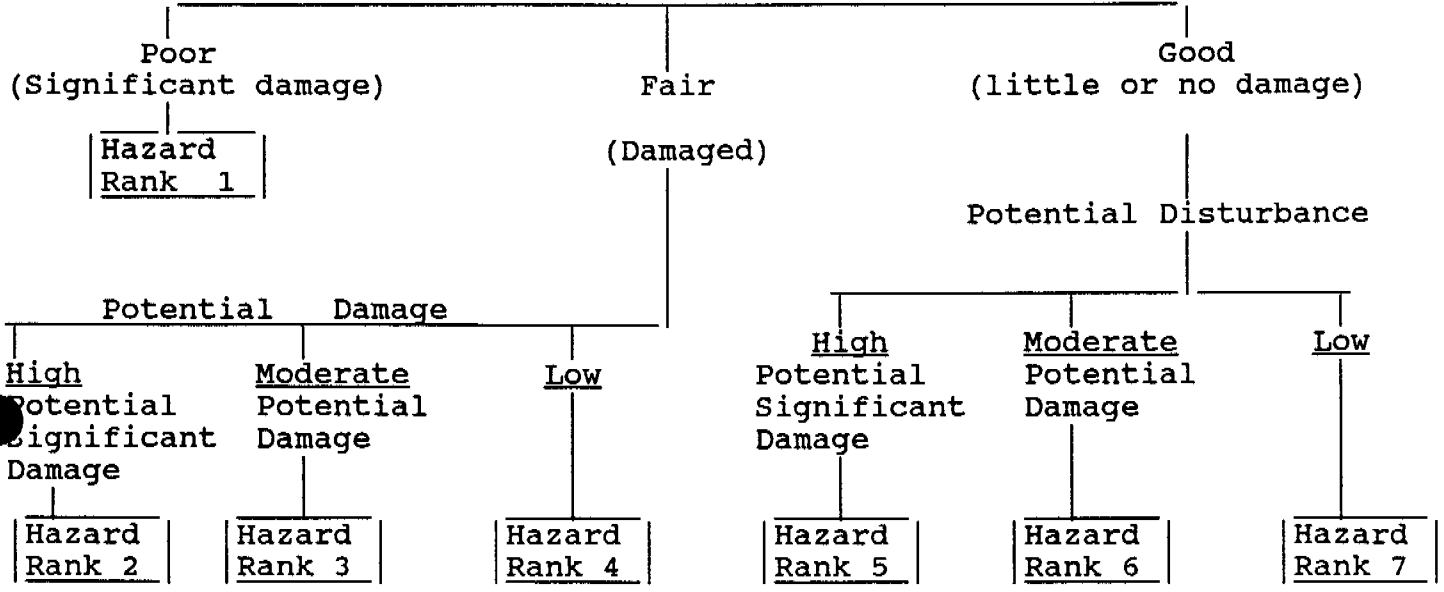

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO H.S.

Date 3/28/88

Building GYM

Inspector JES

Location BOILER RM
(functional area)

HMS-CHS-54

Material: Surfacing (TSI) Misc. % Asbestos 85-90
Description BOILER CASKET

Amount of Material (NF / F) 32/0 (ft²/lf) Assumed ACM: Y / N # of samples _____

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility:	<u>(H)</u>	M	L
Vibration :	H	M	<u>(L)</u>
Air Erosion :	H	M	<u>(L)</u>
Water :	H	M	<u>(L)</u>

PREVENTATIVE MEASURES:


1. Fix Leaks
2. Prevent water contact
- (3) 3. Do not DCSG
4. Do not affix signs/deco's
- (5) 5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS

- isolate/restrict repair/cleanup
- enclose encapsulate
- remove (O&M)

ACBM Condition - Assessment

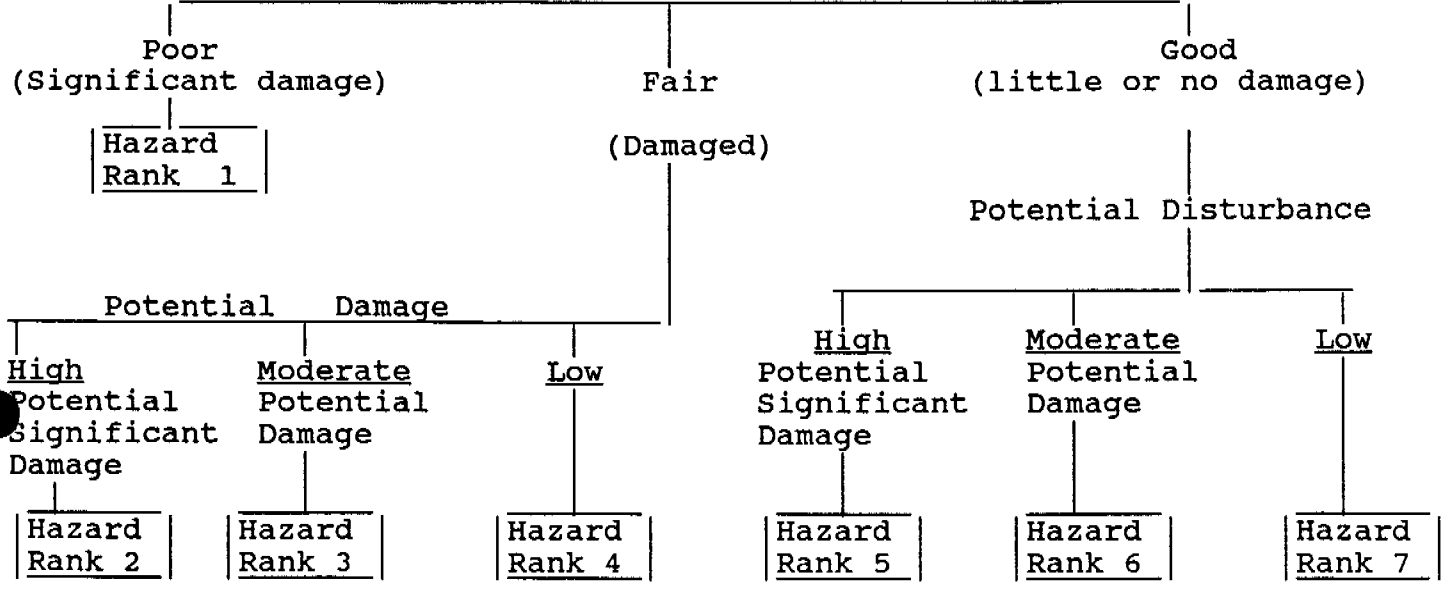

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page ___ of ___

SCHOOL CHICO H.S.

Date 3/29/88

Building LINCOLN HALL

Inspector JES

Location STAGE
(functional area)

HMS-CHS-58

Material: Surfacing TSI Misc. % Asbestos 1-5
Description 1/2" 9" WHITE

Amount of Material (NF / F) 900/0 (ft² / lf) Assumed ACM: Y / N # of samples 1

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility: (H) M L
Vibration : H M (L)
Air Erosion : H M (L)
Water : H M (L)

PREVENTATIVE MEASURES:


1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS

isolate/restrict repair/cleanup
enclose encapsulate
remove O&M

ACBM Condition - Assessment

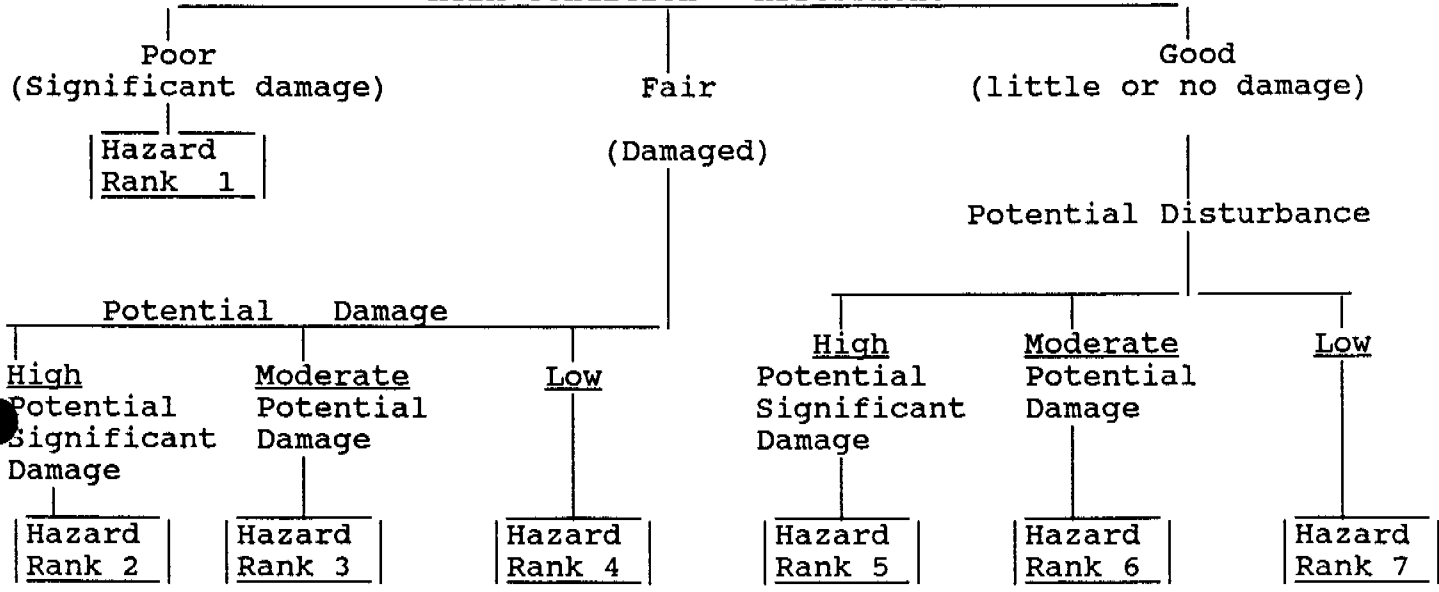

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO H.S.

Date 3/29/88

Building LINCOLN HALL

Inspector JES

Location KITCHEN
(functional area)

HMS-CHS-55

Material: Surfacing TSI Misc. % Asbestos 1-5
Description VFT 9" GREY

Amount of Material (NF / F) 6800/0 (ft²/lf) Assumed ACM: Y / N # of samples

CONDITION: % damaged: Extent of damage: 1
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility: H M L
Vibration : H M L
Air Erosion : H M L
Water : H M L

PREVENTATIVE MEASURES:


1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS

- isolate/restrict repair/cleanup
- enclose encapsulate
- remove O&M

ACBM Condition - Assessment

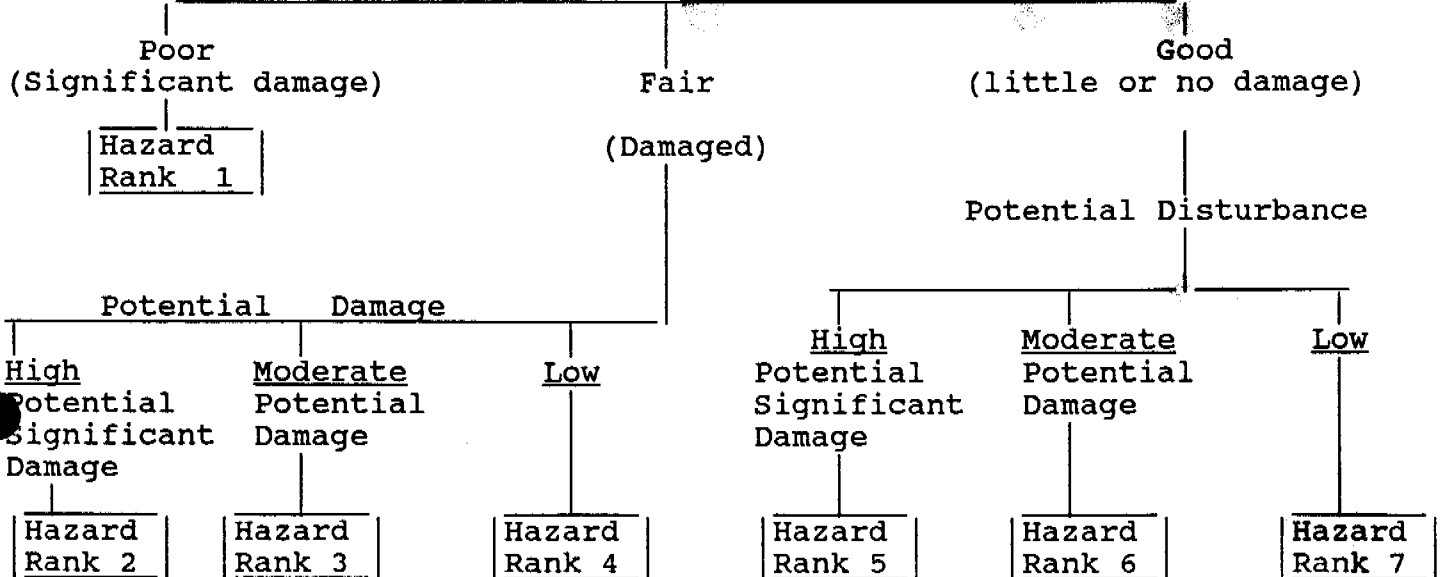

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO H.S.

Date 3/28/88

Building AGRICULTURE BLDG.

Inspector JES

Location CLASS RM # 2
(functional area)

HMS-CHS-46B, B, C

Material: Surfacing TSI Misc. % Asbestos 1-5
Description WALL PLASTER

Amount of Material (NF / F) 950 / 0 (ft² lf) Assumed ACM: Y / N # of samples

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION: _____

POTENTIAL FOR DISTURBANCE:

Accessibility:	H	M	<u>L</u>
Vibration :	H	M	<u>L</u>
Soil Erosion :	H	M	<u>L</u>
Water :	H	M	<u>L</u>

PREVENTATIVE MEASURES:


1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS: _____

REMEDIAL ACTIONS

- isolate/restrict repair/cleanup
- enclose encapsulate
- remove O&M

ACBM Condition - Assessment

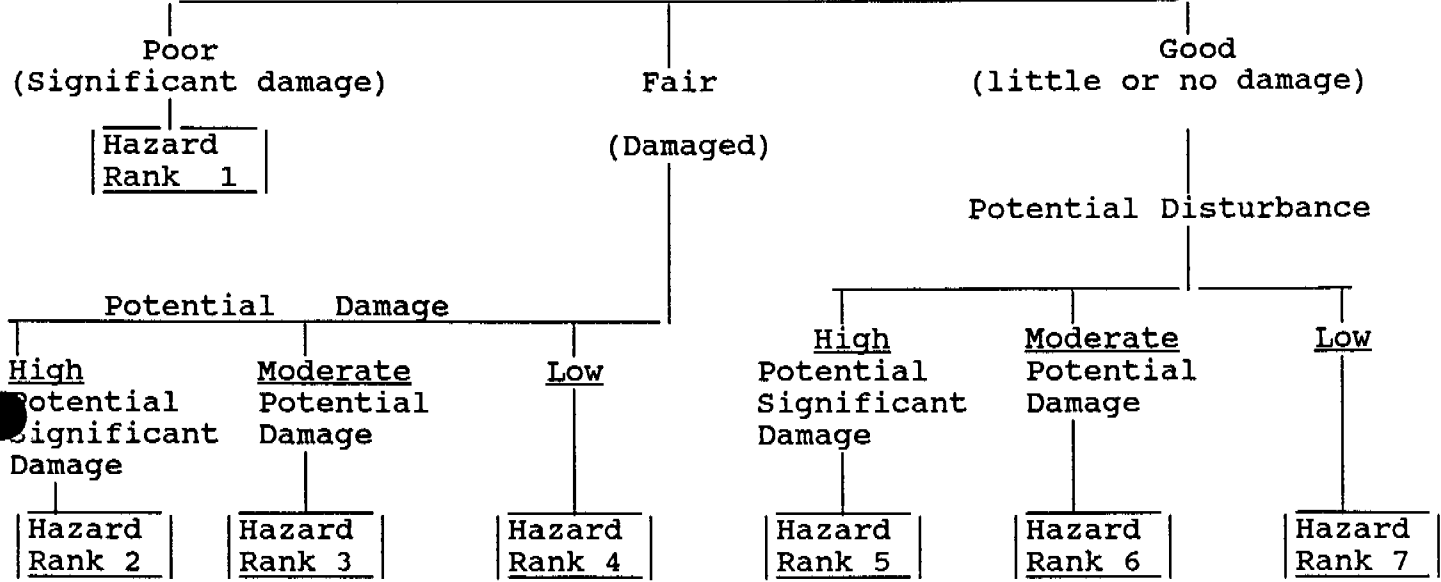

Inspection Form I-1

DISTRICT _____

Page _____ of _____

SCHOOL CHICO HS

Date 3/28/88

Building H

Inspector JES

Location MUSIC WING HALL
(functional area)

HMS-~~445~~ - ~~39~~

Material: Surfacing TSI Misc. % Asbestos 5-10
Description VFT 9" YELLOW

Amount of Material (NF / F) 810/0 (ft²/lf) Assumed ACM: Y / N # of samples 1

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION:

POTENTIAL FOR DISTURBANCE:

Accessibility: H M L
Vibration : H M L
Air Erosion : H M L
Water : H M L


PREVENTATIVE MEASURES:

- 1. Fix Leaks
- 2. Prevent water contact
- 3. Do not DCSG
- 4. Do not affix signs/deco's
- 5. Avoid contact

COMMENTS:

REMEDIAL ACTIONS
isolate/restrict repair/cleanup
enclose encapsulate
remove O&M

ACBM Condition - Assessment

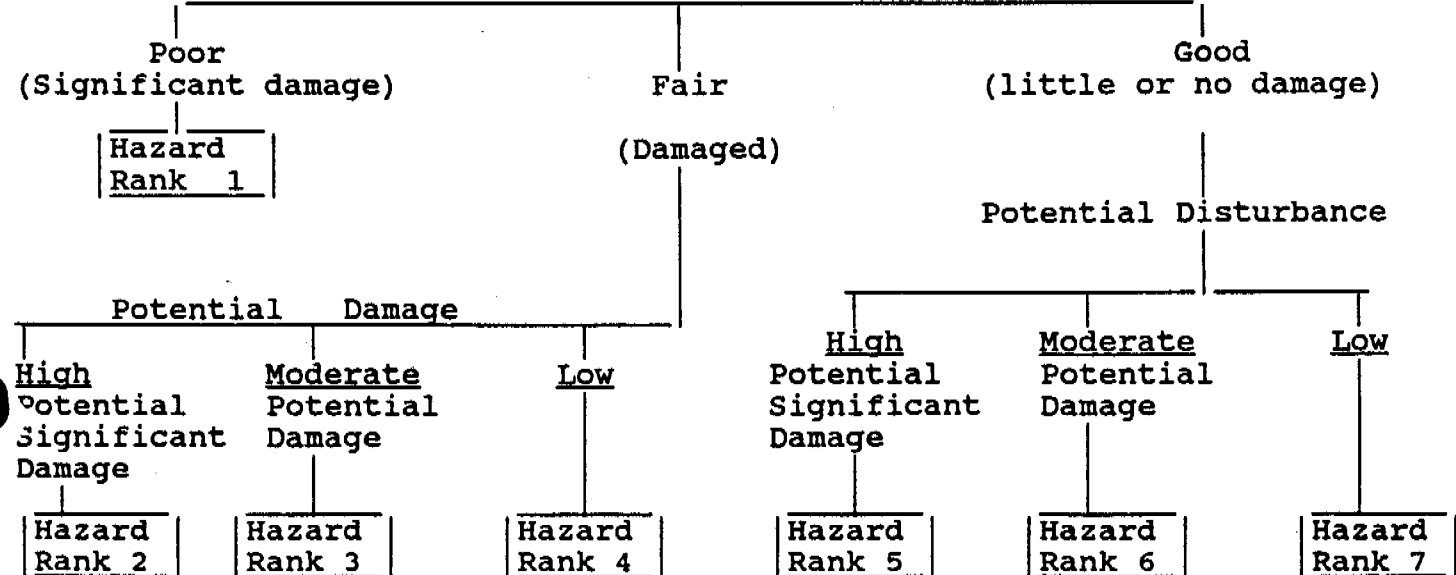

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT CHICO

Page of

SCHOOL CHICO H.S.

Date 2-28-88

Building S

Inspector JES

Location S-4
(functional area)

HMS-CHS-24

Material: Surfacing TSI Misc. % Asbestos 1-5
Description UFT 9" BEIGE

Amount of Material (NF / F) 8,100/0 (ft² lf) Assumed ACM: Y / N # of samples 1

CONDITION: % damaged: 0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION:

POTENTIAL FOR DISTURBANCE:

PREVENTATIVE MEASURES:

Accessibility: (H) M L
Vibration : H M (L)
Air Erosion : H M (L)
Water : H M (L)

1. Fix Leaks
2. Prevent water contact
- (3) 3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact


COMMENTS:

REMEDIAL ACTIONS
isolate/restrict repair/cleanup

enclose encapsulate

remove (O&M)

ACBM Condition - Assessment

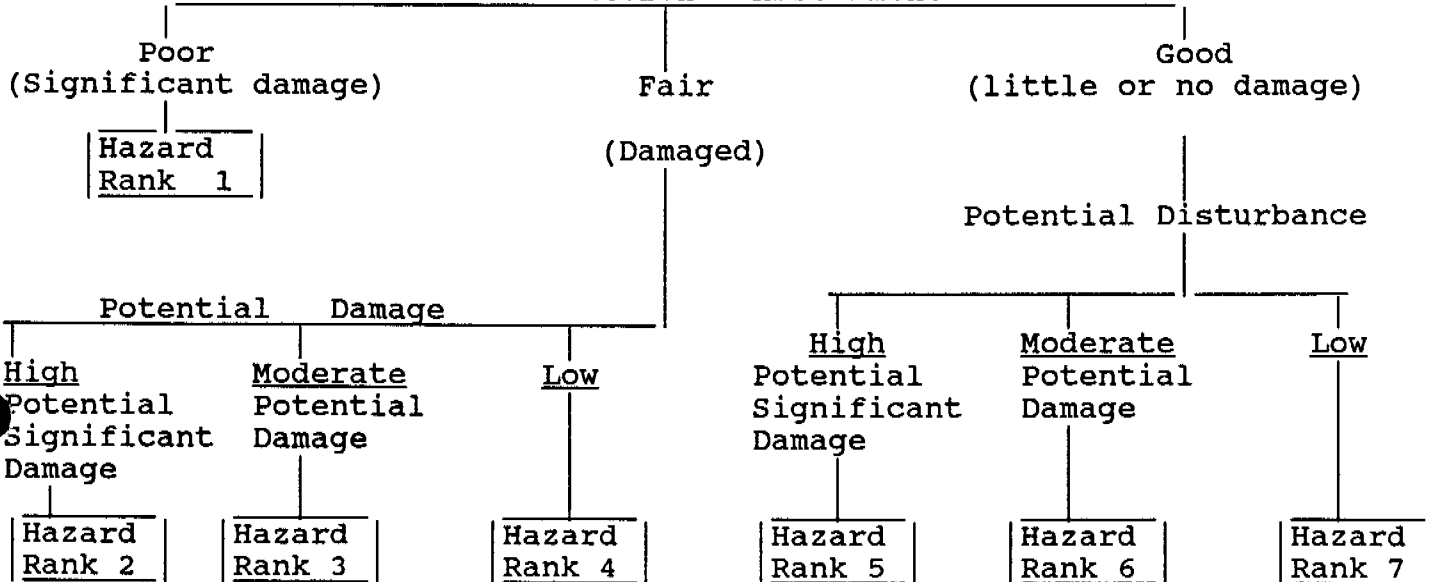

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT CHICO
 SCHOOL CHICO H.S.
 Building C
 Location RM-10
 (functional area)

Page 14 of 54
 Date 3-28-88
 Inspector JES
 HMS-CHS-14

Material: Surfacing TSI Misc. % Asbestos 1-5
 Description VFT 12" BEIGE

Amount of Material (NF / F) 3,513/0 (ft²/lf) Assumed ACM: Y / N # of samples 1

CONDITION: % damaged: Extent of damage:
0% <1% 1-10% 11-25% >25% none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION:

POTENTIAL FOR DISTURBANCE:

Accessibility: (H) M L
 Vibration : H M (L)
 Air Erosion : H M (L)
 Water : H M (L)


PREVENTATIVE MEASURES:

1. Fix Leaks
2. Prevent water contact
- (3) 3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS:

REMEDIAL ACTIONS
 isolate/restrict repair/cleanup
 enclose encapsulate
 remove (O&M)

ACBM Condition - Assessment

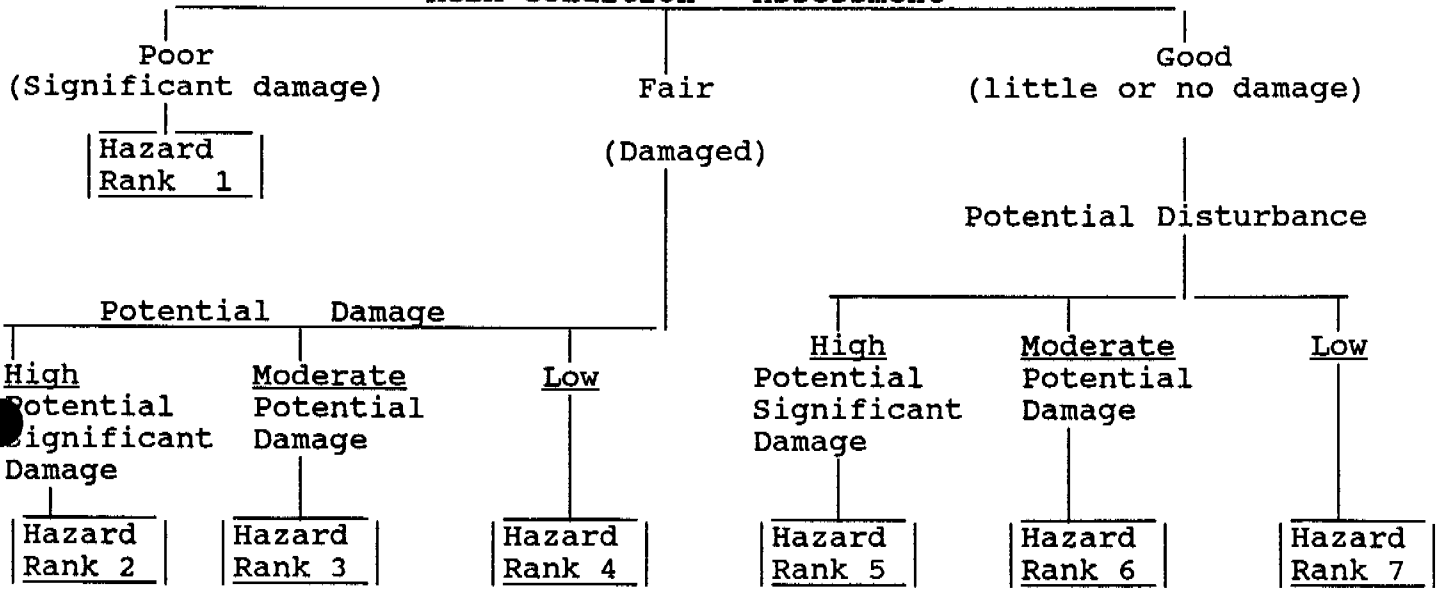

HAZARD MANAGEMENT SERVICES, INC.

Inspection Form I-1

DISTRICT CHICO

Page 8 of 54

SCHOOL CHICO H.S.

Date 3-28-88

Building MAIN BLDG. 1st Fl.

Inspector JES

Location DARK RM ATTIC
(functional area)

HMS-CHS - 08

Material: Surfacing TSI Misc. % Asbestos 15-20
Description MESH WRAP

Amount of Material (NF / F) 1/2 / 0 (ft² / lf) Assumed ACM: Y / N # of samples

CONDITION: % damaged: 0% <1% 1-10% 11-25% >25% Extent of damage: none local distributed

Type damage: air; deterioration; water; physical; flaking

DESCRIPTION:

POTENTIAL FOR DISTURBANCE:

PREVENTATIVE MEASURES:

Accessibility:	H	M	<u>L</u>
Vibration :	H	M	<u>L</u>
Air Erosion :	H	M	<u>L</u>
Water :	H	M	<u>L</u>

1. Fix Leaks
2. Prevent water contact
3. Do not DCSG
4. Do not affix signs/deco's
5. Avoid contact

COMMENTS:

REMEDIAL ACTIONS
isolate/restrict repair/cleanup

enclose encapsulate

remove O&M

ACBM Condition - Assessment

